

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber: **230056**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7748 Ashburnham, Camp Winnakeag, Ashby Rd					
<i>Sampled: 7/12/2021 1:59:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	360	2	7/12/2021 3:35:00 PM	M-MA1118

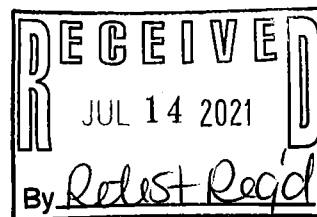

COM

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428 Fax: 978-391-4643

LabNumber: **230260**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/15/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7782 Ashburnham, Camp Winnakeag, Ashby Rd					
Sampled: 7/14/2021 1:45:00 PM by Rick Metcalf					
E.coli, /100ML	EPA 1603	14	2	7/14/2021 3:30:00 PM	M-MA1118

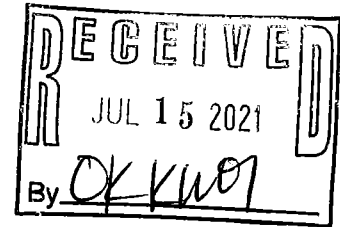

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

A handwritten signature in black ink, which appears to read "David L. Knowlton".

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230051

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health

30 Central Avenue

Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7745 Lunenburg, Hickory Hills, Brookview					
<i>Sampled: 7/12/2021 12:53:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	294	2	7/12/2021 3:35:00 PM	M-MA1118

RECEIVED
 JUL 14 2021
 By *Robert Reid*

DR

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230193

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/15/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7780 Lunenburg, Hickory Hills, Brookview					
<i>Sampled: 7/14/2021 9:10:00 AM by J. Garreff, NABH</i>					
E.coli, /100ML	EPA 1603	44	2	7/14/2021 11:50:00 AM	M-MA1118

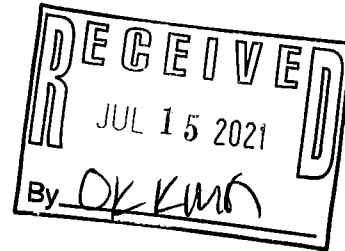

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified

Laboratory #M-MA1118

A handwritten signature in black ink, appearing to read "David L. Knowlton".

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230000

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7729 Bolton, Tom Denny Camp. Flanagan Rd					
<i>Sampled: 7/12/2021 7:11:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	376	2	7/12/2021 1:25:00 PM	M-MA1118

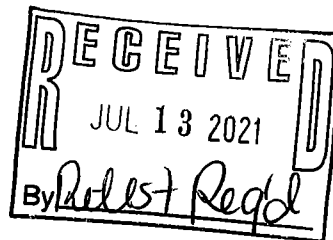

km

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified

Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230192

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/15/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7779 Bolton, Tom Denny Camp. Flanagan Rd					
<i>Sampled: 7/14/2021 7:55:00 AM by J. Garreff, NABH</i>					
E.coli, /100ML	EPA 1603	30	2	7/14/2021 11:50:00 AM	M-MA1118

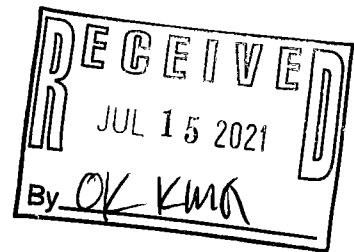

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified

Laboratory #M-MA1118

A handwritten signature in cursive script, appearing to read "David L. Knowlton".

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230107

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/14/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7775 Lunenburg, Town Beach					
<i>Sampled: 7/13/2021 11:30:00 AM by JAG</i>					
E.coli, /100ML	EPA 1603	282	2	7/13/2021 2:50:00 PM	M-MA1118

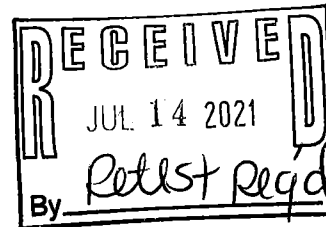

mm

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428 Fax: 978-391-4643

LabNumber: **230276**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/15/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7783 Lunenburg, Town Beach					
<i>Sampled: 7/14/2021 4:00:00 PM by JAG</i>					
E.coli, /100ML	EPA 1603	164	2	7/14/2021 3:30:00 PM	M-MA1118

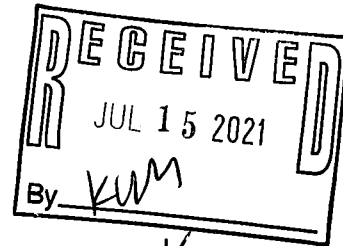

OK

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230001

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7331 Stow, Town Beach					
<i>Sampled: 7/12/2021 7:58:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	14	2	7/12/2021 1:25:00 PM	M-MA1118

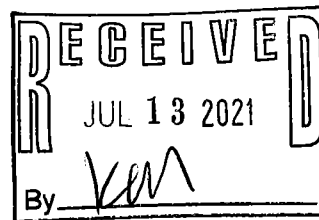

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=81/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230002

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7732 Harvard, Town of Harvard					
<i>Sampled: 7/12/2021 8:28:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	50	2	7/12/2021 1:25:00 PM	M-MA1118

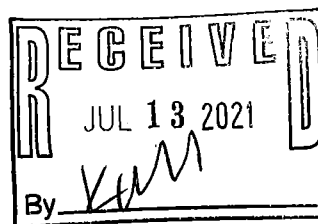

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified

Laboratory #M-MA1118

A handwritten signature in black ink, appearing to read "David L. Knowlton".

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230003

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7733 Littleton, Town Beach					
<i>Sampled: 7/12/2021 8:53:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	22	2	7/12/2021 1:25:00 PM	M-MA1118

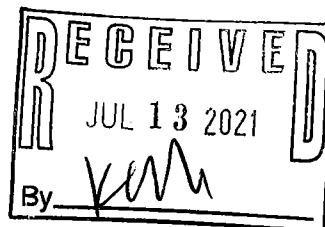

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230004

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7734 Groton, Town Beach					
<i>Sampled: 7/12/2021 9:14:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	4	2	7/12/2021 1:25:00 PM	M-MA1118

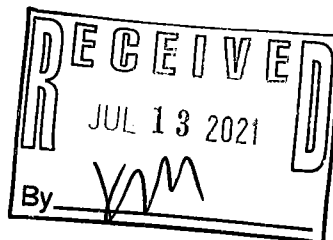

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=81/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230005

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7735 Groton, Baby Beach					
<i>Sampled: 7/12/2021 9:31:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	40	2	7/12/2021 1:26:00 PM	M-MA1118

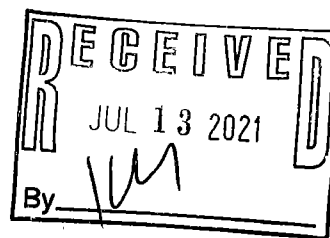

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

A handwritten signature in black ink, appearing to read "David L. Knowlton".

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230006

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7736 Groton, GrotonWood Camp,Prescott Rd					
<i>Sampled: 7/12/2021 9:52:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	28	2	7/12/2021 1:25:00 PM	M-MA1118

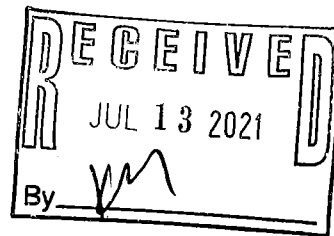

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

A handwritten signature in black ink, appearing to read "David L. Knowlton".

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428 Fax: 978-391-4643

LabNumber: **230007**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7737 Ayer, Town Beach					
<i>Sampled: 7/12/2021 10:12:00 AM by Matthew Saunders</i>					
E.coli, /100ML	EPA 1603	26	2	7/12/2021 1:25:00 PM	M-MA1118

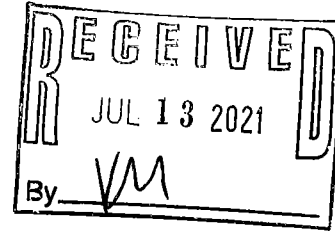

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428 Fax: 978-391-4643

LabNumber: **230008**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7738 Bolton, Town Beach					
Sampled: 7/12/2021 7:34:00 AM by Matthew Saunders					
E.coli, /100ML	EPA 1603	88	2	7/12/2021 1:25:00 PM	M-MA1118

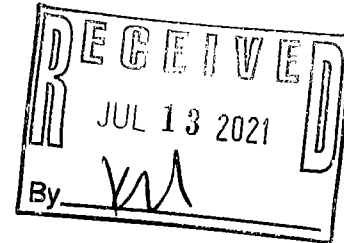

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified

Laboratory #M-MA1118

A handwritten signature in black ink, appearing to read "David L. Knowlton".

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber: **230037**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence

Client:

Nashoba Assoc. Boards of Health


30 Central Avenue

Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7739 Devens, Mirror Lake, Patten Rd					
Sampled: 7/12/2021 11:28:00 AM by M Saunders					
E.coli, /100ML	EPA 1603	80	2	7/12/2021 3:35:00 PM	M-MA1118

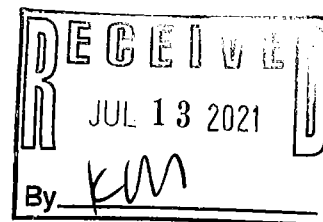

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230040

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7740 Lancaster, Camp Lowe, Ft. Pond Inn Rd					
<i>Sampled: 7/12/2021 11:48:00 AM by M Saunders</i>					
E.coli, /100ML	EPA 1603	38	2	7/12/2021 3:35:00 PM	M-MA1118

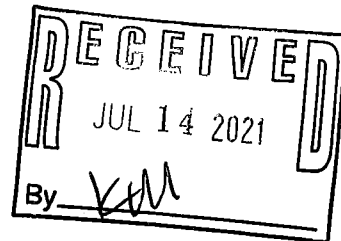

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230042

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7741 Lancaster, Town Beach, Fire Road 4					
<i>Sampled: 7/12/2021 12:13:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	44	2	7/12/2021 3:35:00 PM	M-MA1118

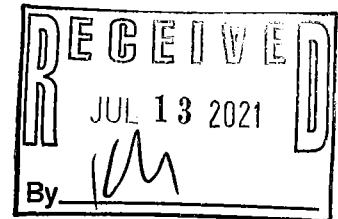

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230043

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7742 Lancaster, 10 Fire Rd. #12 (JCC)					
<i>Sampled: 7/12/2021 12:11:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	6	2	7/12/2021 3:35:00 PM	M-MA1118

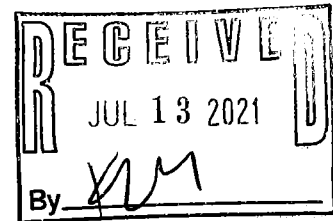

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428 Fax: 978-391-4643

LabNumber: **230048**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7744 Lunenburg, Hickory Hemlock, Hemlock Dr					
<i>Sampled: 7/12/2021 12:41:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	136	2	7/12/2021 3:35:00 PM	M-MA1118

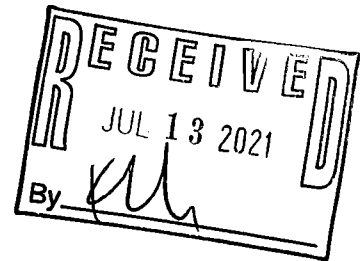

Recreational Water Limits:
 E.coli Limit= 235/100ml
 Enterococcus Limit=61/100ml
 MRL = Minimum Reporting Level
 Analysis performed according to 310CMR42.00
 Massachusetts Certified
 Laboratory #M-MA1118

David L. Knowlton
 David L. Knowlton
 Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230045

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7743 Lunenburg, Hickory Hill, Island Rd					
<i>Sampled: 7/12/2021 12:34:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	34	2	7/12/2021 3:35:00 PM	M-MA1118

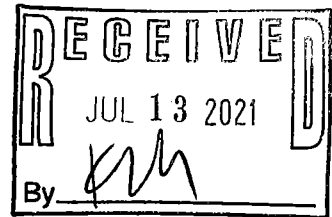

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428 Fax: 978-391-4643

LabNumber: **230053**

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7746 Lunenburg, Lake Whalom (Emerald Place)					
<i>Sampled: 7/12/2021 1:09:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	150	2	7/12/2021 3:35:00 PM	M-MA1118

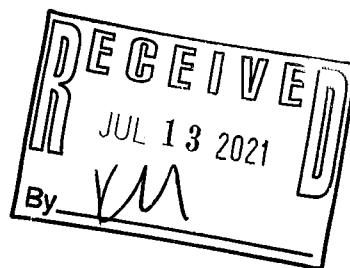

Recreational Water Limits:
 E.coli Limit= 235/100ml
 Enterococcus Limit=81/100ml
 MRL = Minimum Reporting Level
 Analysis performed according to 310CMR42.00
 Massachusetts Certified
 Laboratory #M-MA1118

David L. Knowlton
 David L. Knowlton
 Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230054

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7747 Ashby, Camp Lapham - South Rd Swim Area					
<i>Sampled: 7/12/2021 1:38:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1603	52	2	7/12/2021 3:35:00 PM	M-MA1118

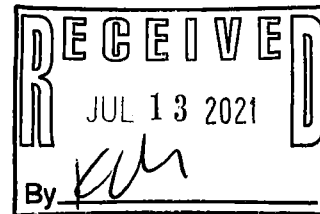

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director

Nashoba Analytical, LLC

Tel: 978-391-4428

Fax: 978-391-4643

LabNumber:

230054

31A Willow Road, Ayer MA 01432

Website: <http://www.NashobaAnalytical.com>

Use this number with all correspondence


Client:

Nashoba Assoc. Boards of Health
30 Central Avenue
Ayer, MA 01432

ReportDate: 7/13/2021

Certificate of Analysis

Parameter	Method	Result	MRL	Date of Analysis	Analyst
NABH# NA7747 Ashby, Camp Lapham - South Rd Swim Area					
<i>Sampled: 7/12/2021 1:38:00 PM by M Saunders</i>					
E.coli, /100ML	EPA 1803	52	2	7/12/2021 3:35:00 PM	M-MA1118

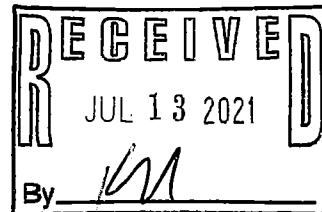

Recreational Water Limits:

E.coli Limit= 235/100ml

Enterococcus Limit=61/100ml

MRL = Minimum Reporting Level

Analysis performed according to 310CMR42.00

Massachusetts Certified
Laboratory #M-MA1118

David L. Knowlton
Laboratory Director